



- FURN001
COND001
- FURN002
COND002
- FURN003
COND003
- FURN004
COND004
- FURN006
COND006
- FURN005
COND005

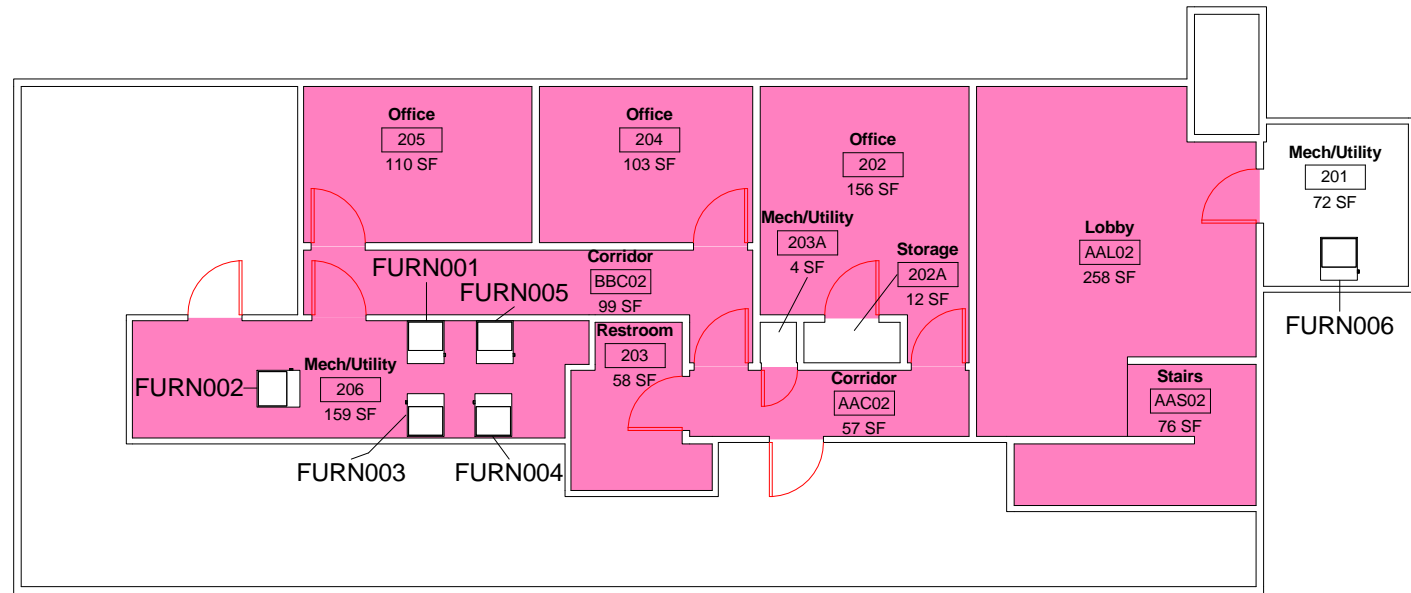

② Air Handling Units 2
3/32" = 1'-0"

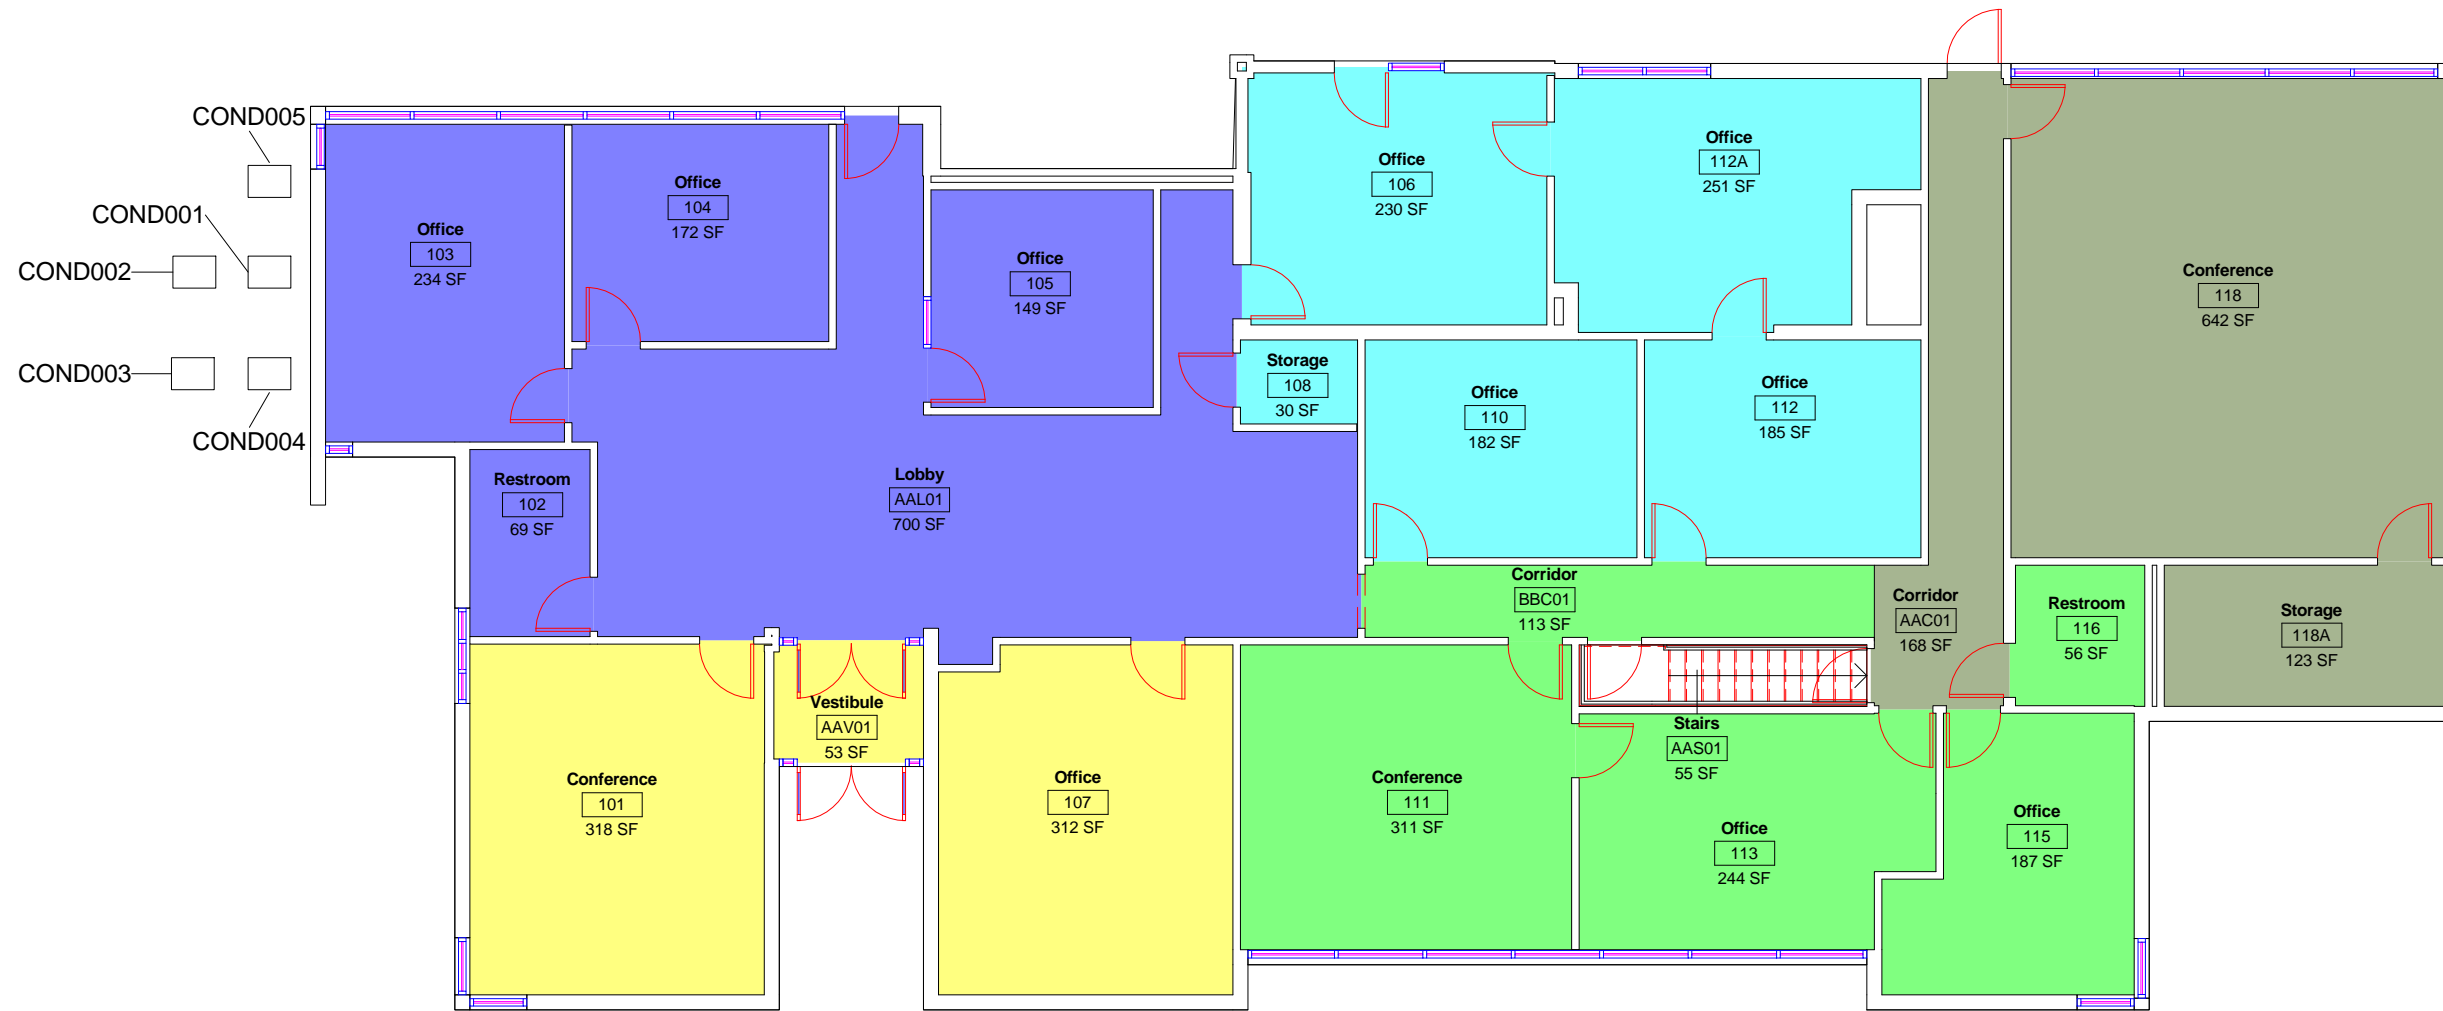

① Air Handling Units 1
3/32" = 1'-0"



SCALE: 3/32" = 1'-0"

DWN	DATE
STK	5/30/2014
REV.	DATE

Ellis House
HVAC Service Areas



M1